




Dexter Project Boat Ramps - 30 days

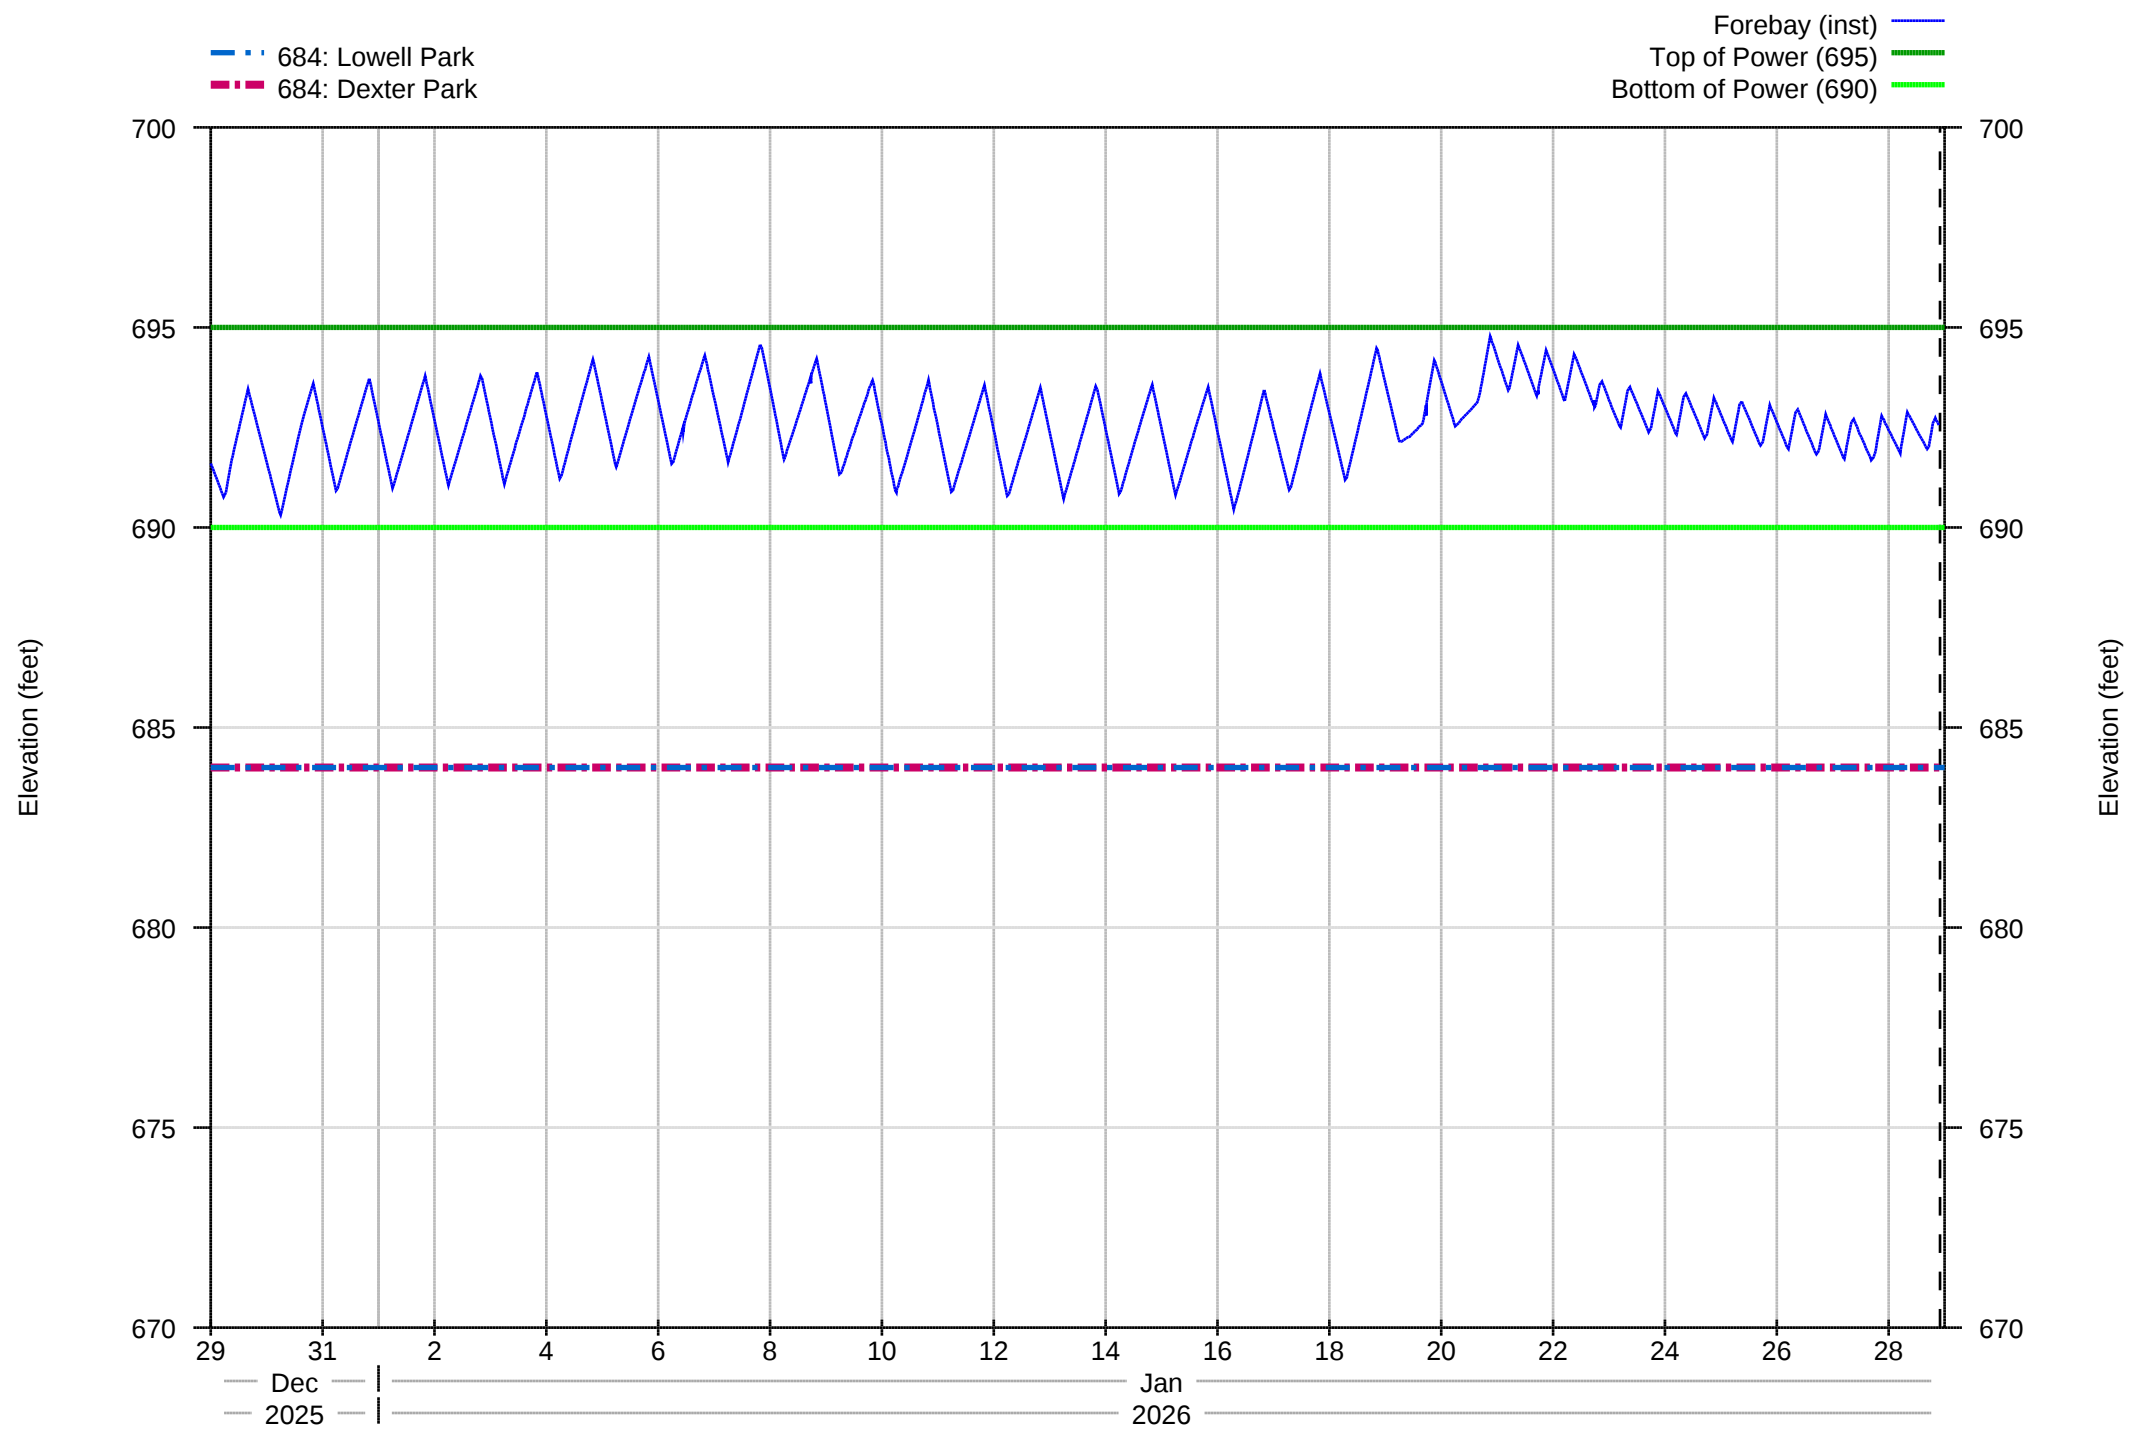


Dexter Project Detail - 7 days

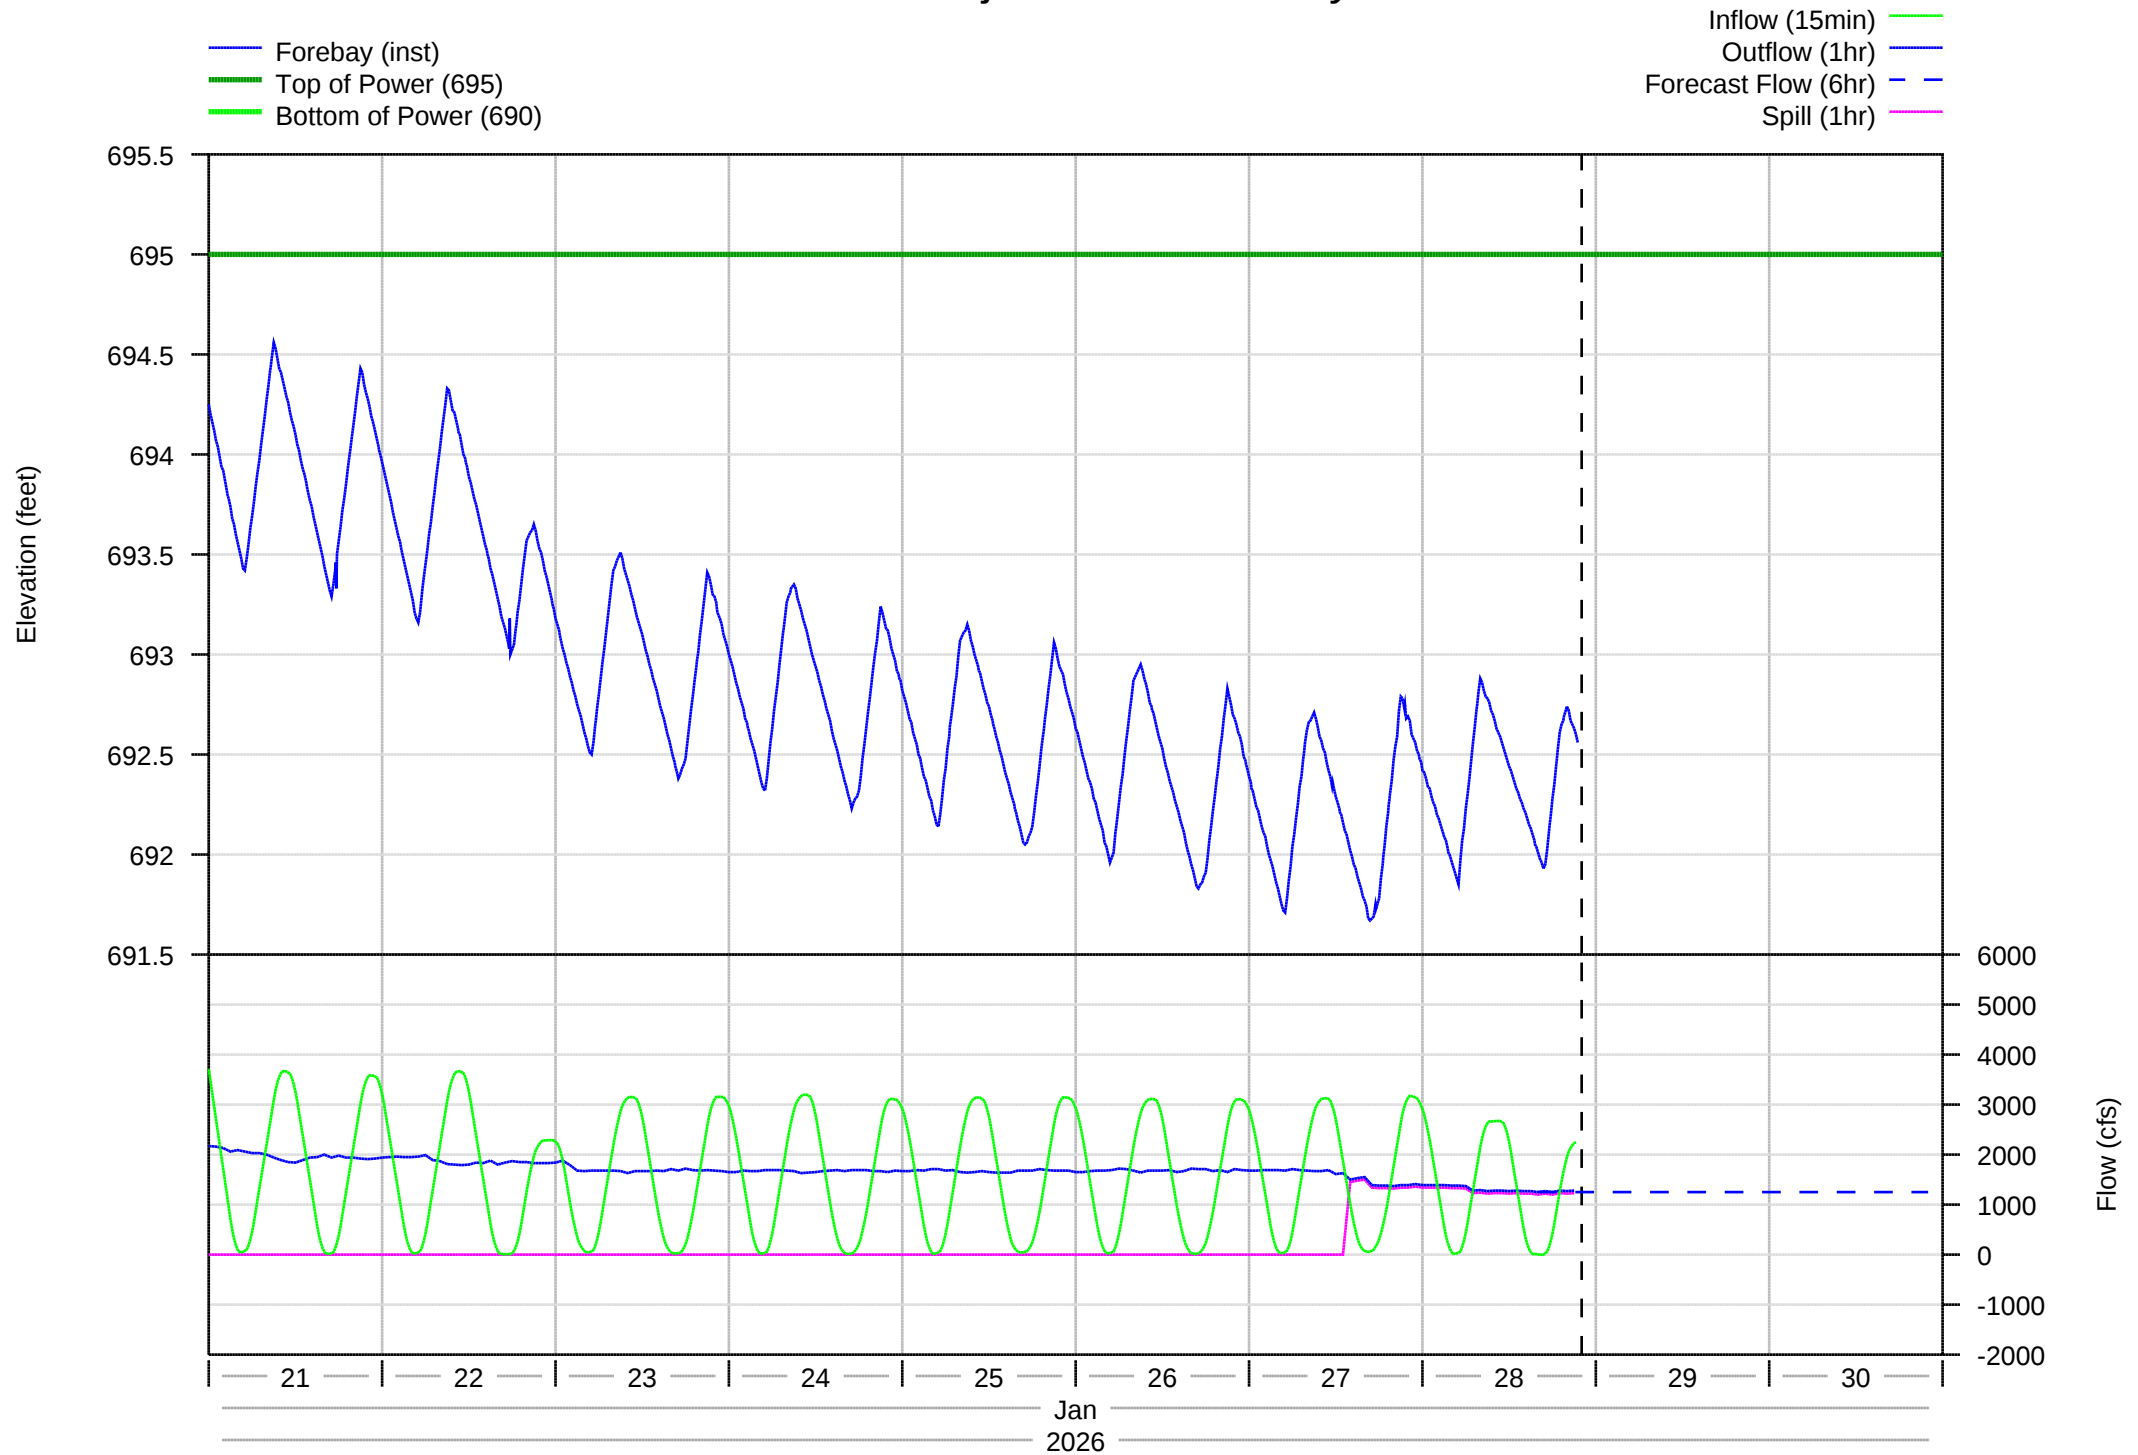


Dexter Project Detail - 30 days

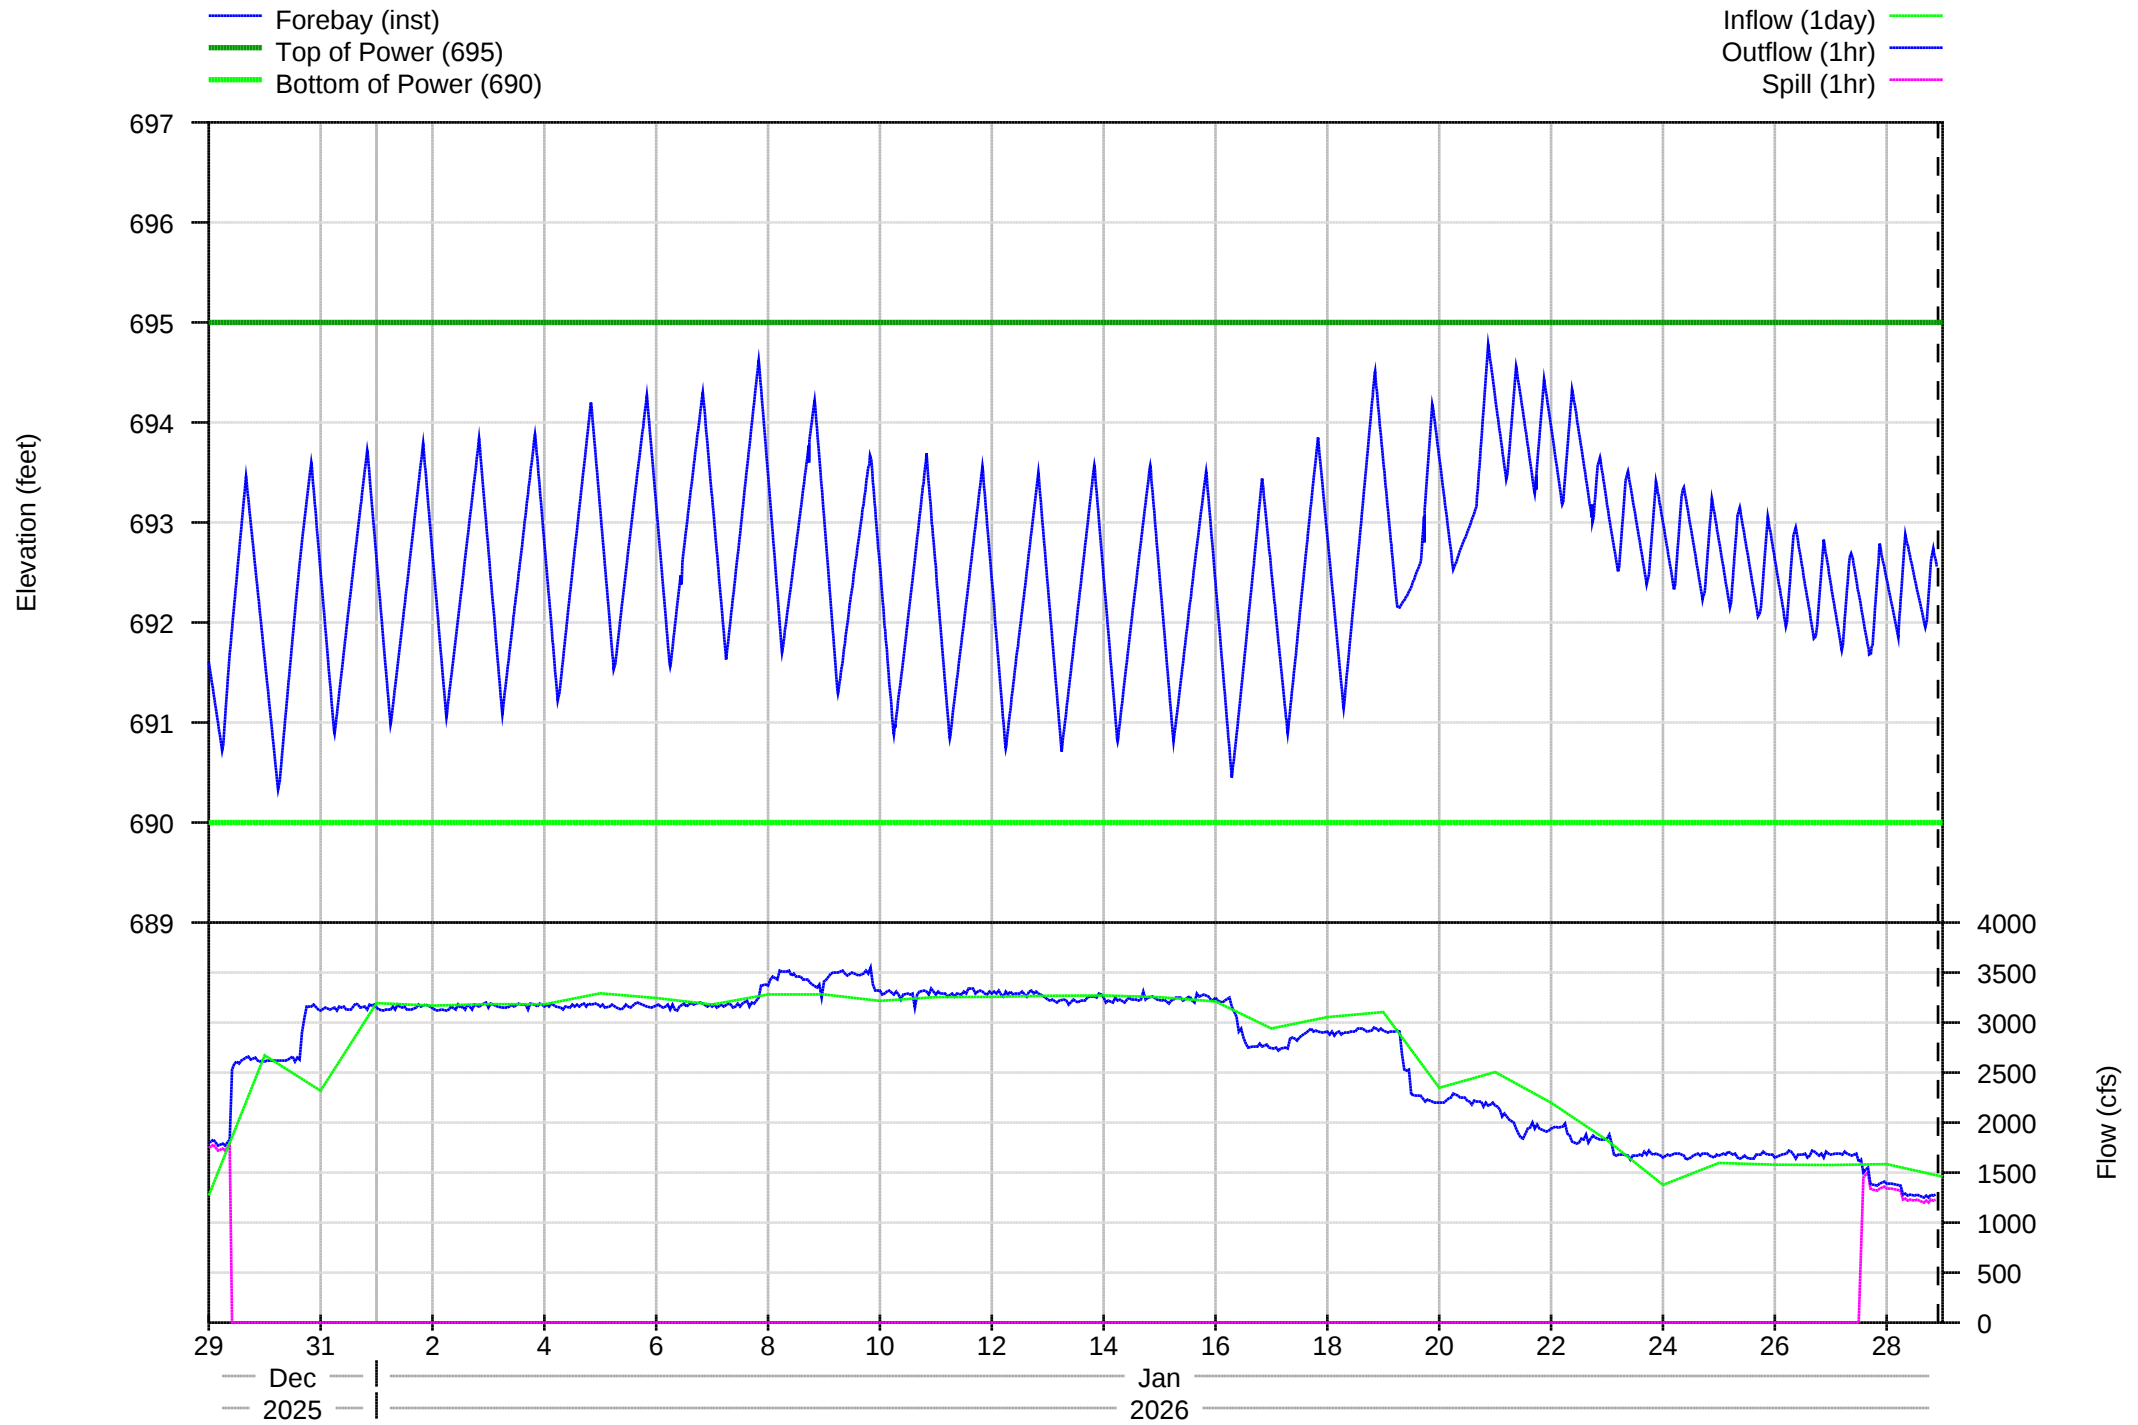

Dexter Project Annual

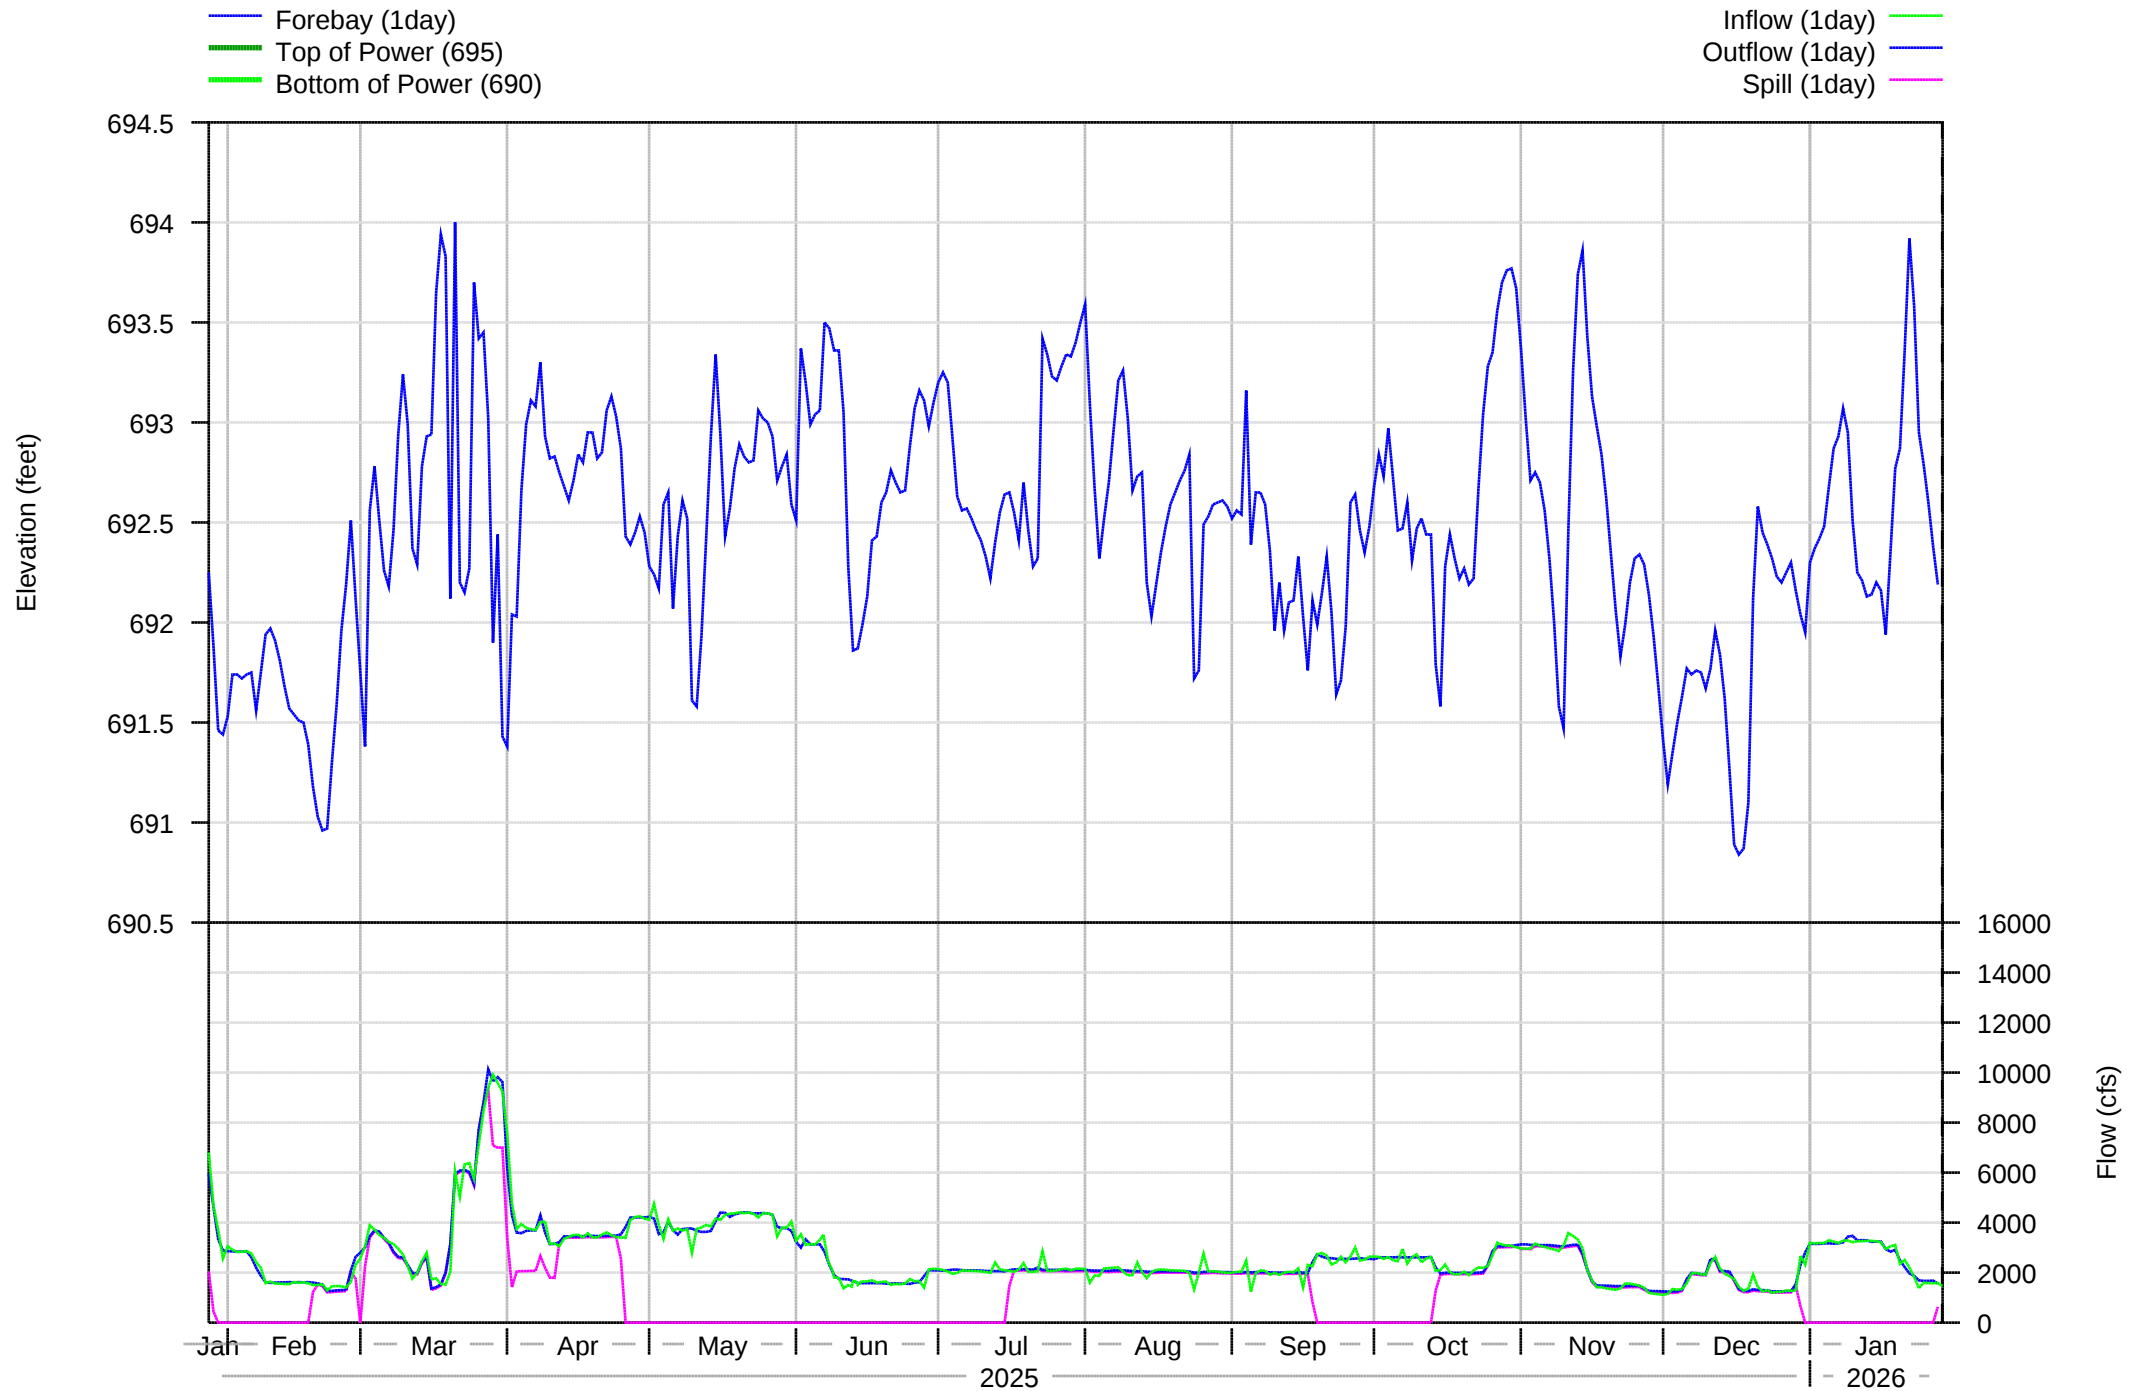


Dexter Project Temperatures - 7 days

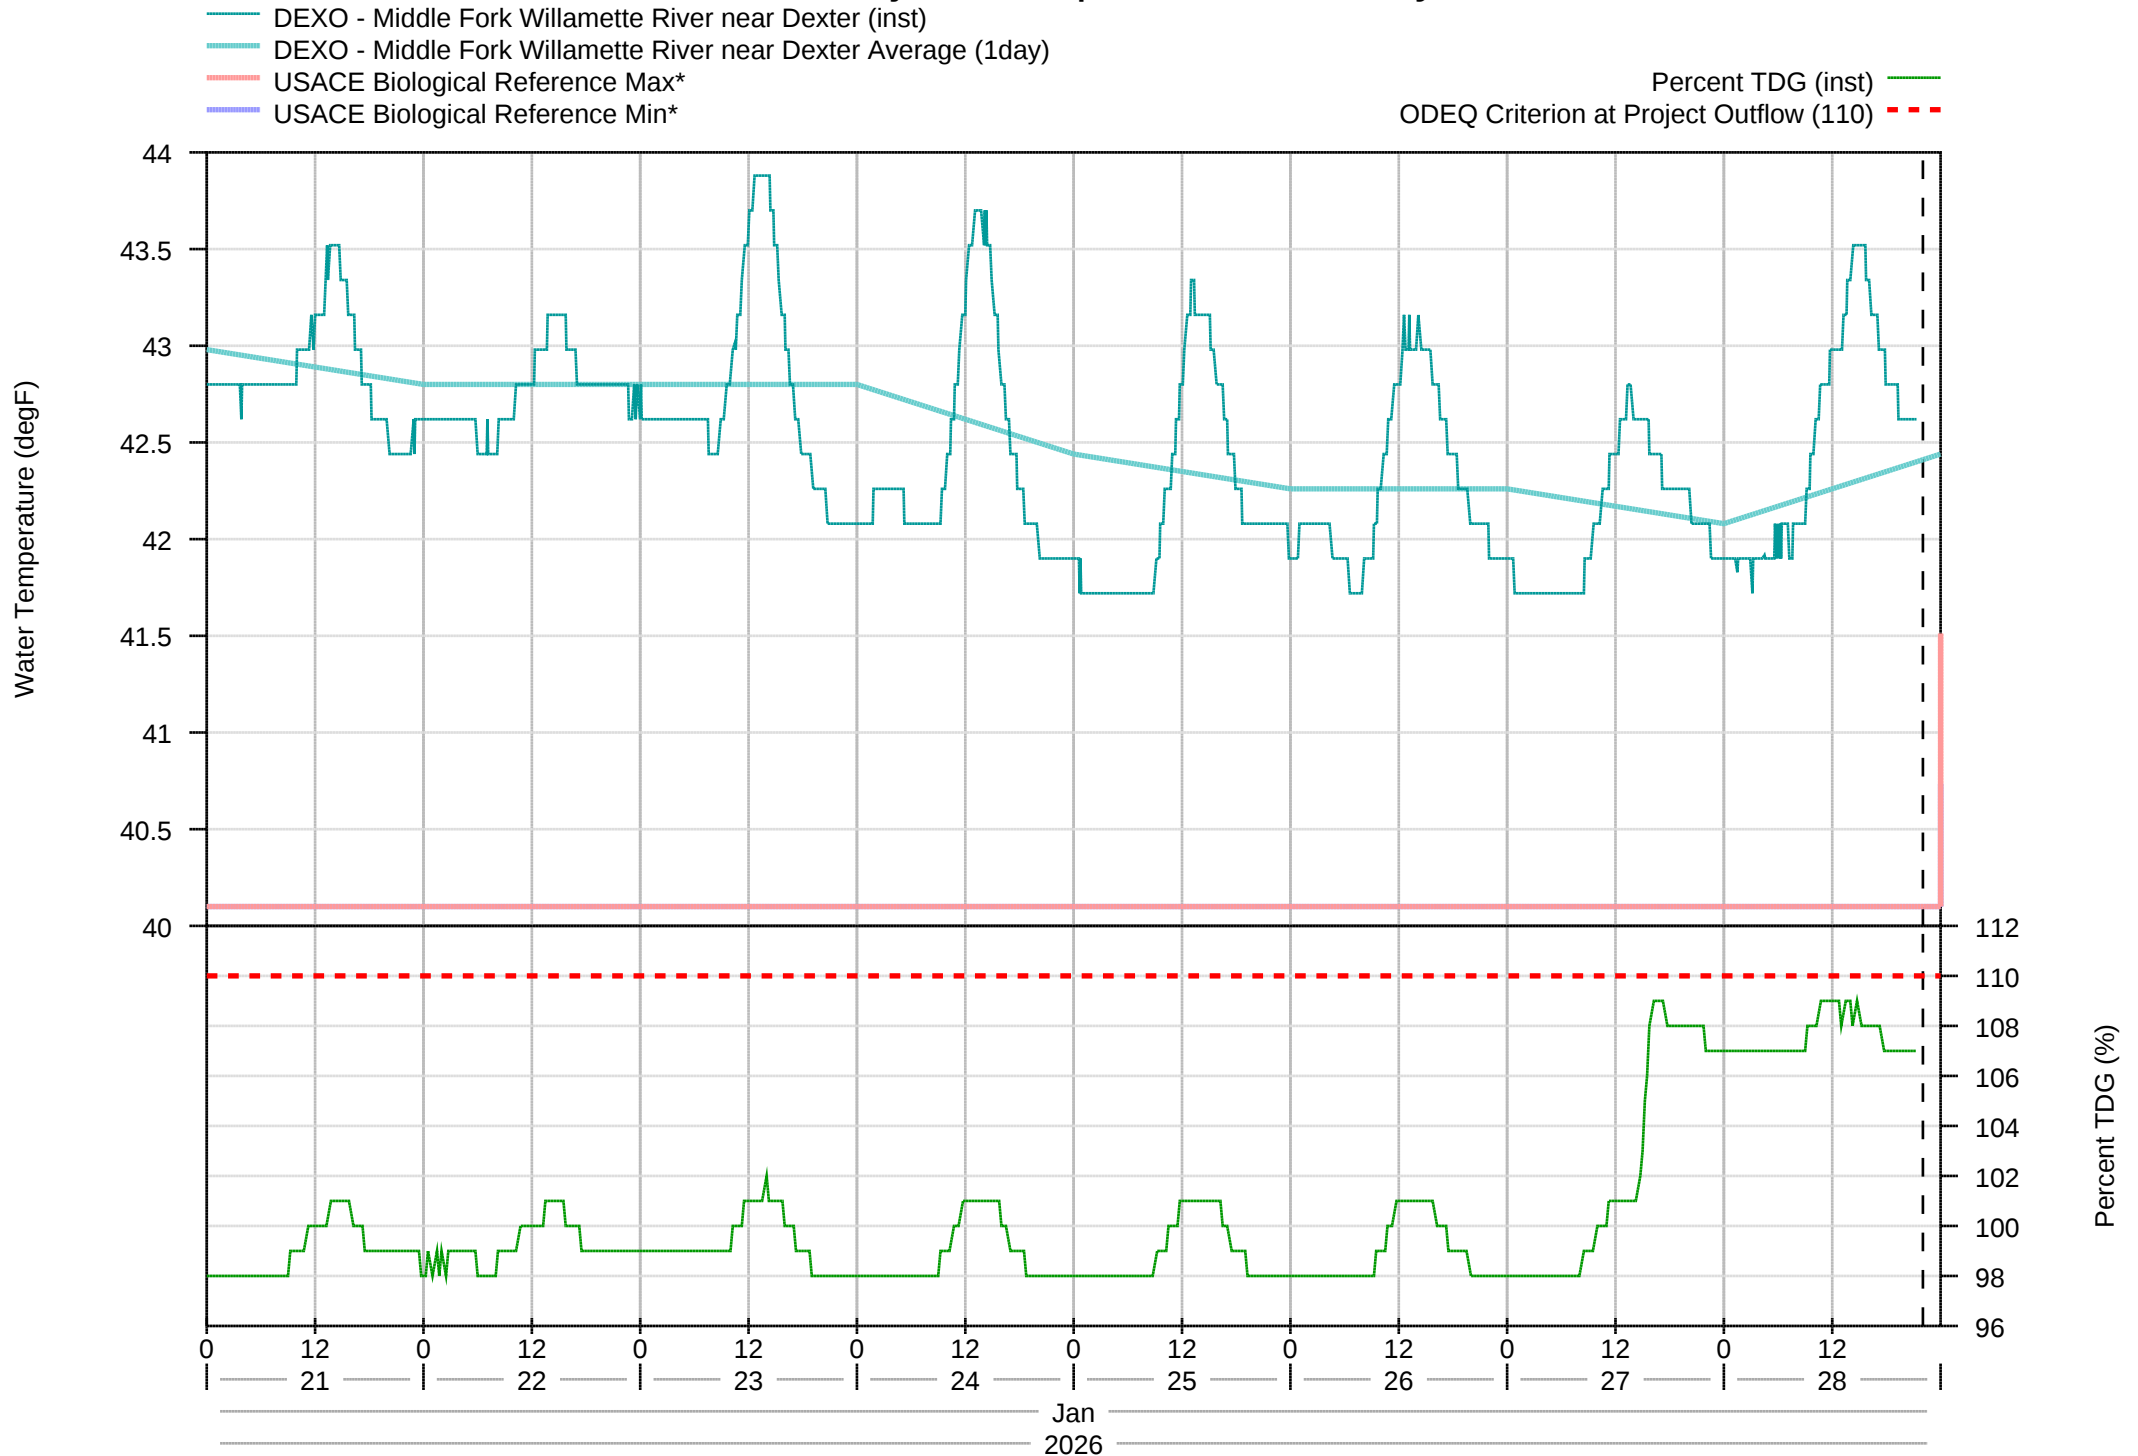


*The USACE Biological References for minimum and maximum temperatures are unofficial guidelines used by the USACE to compare with measured temperatures.

Dexter Project Temperatures - 30 days

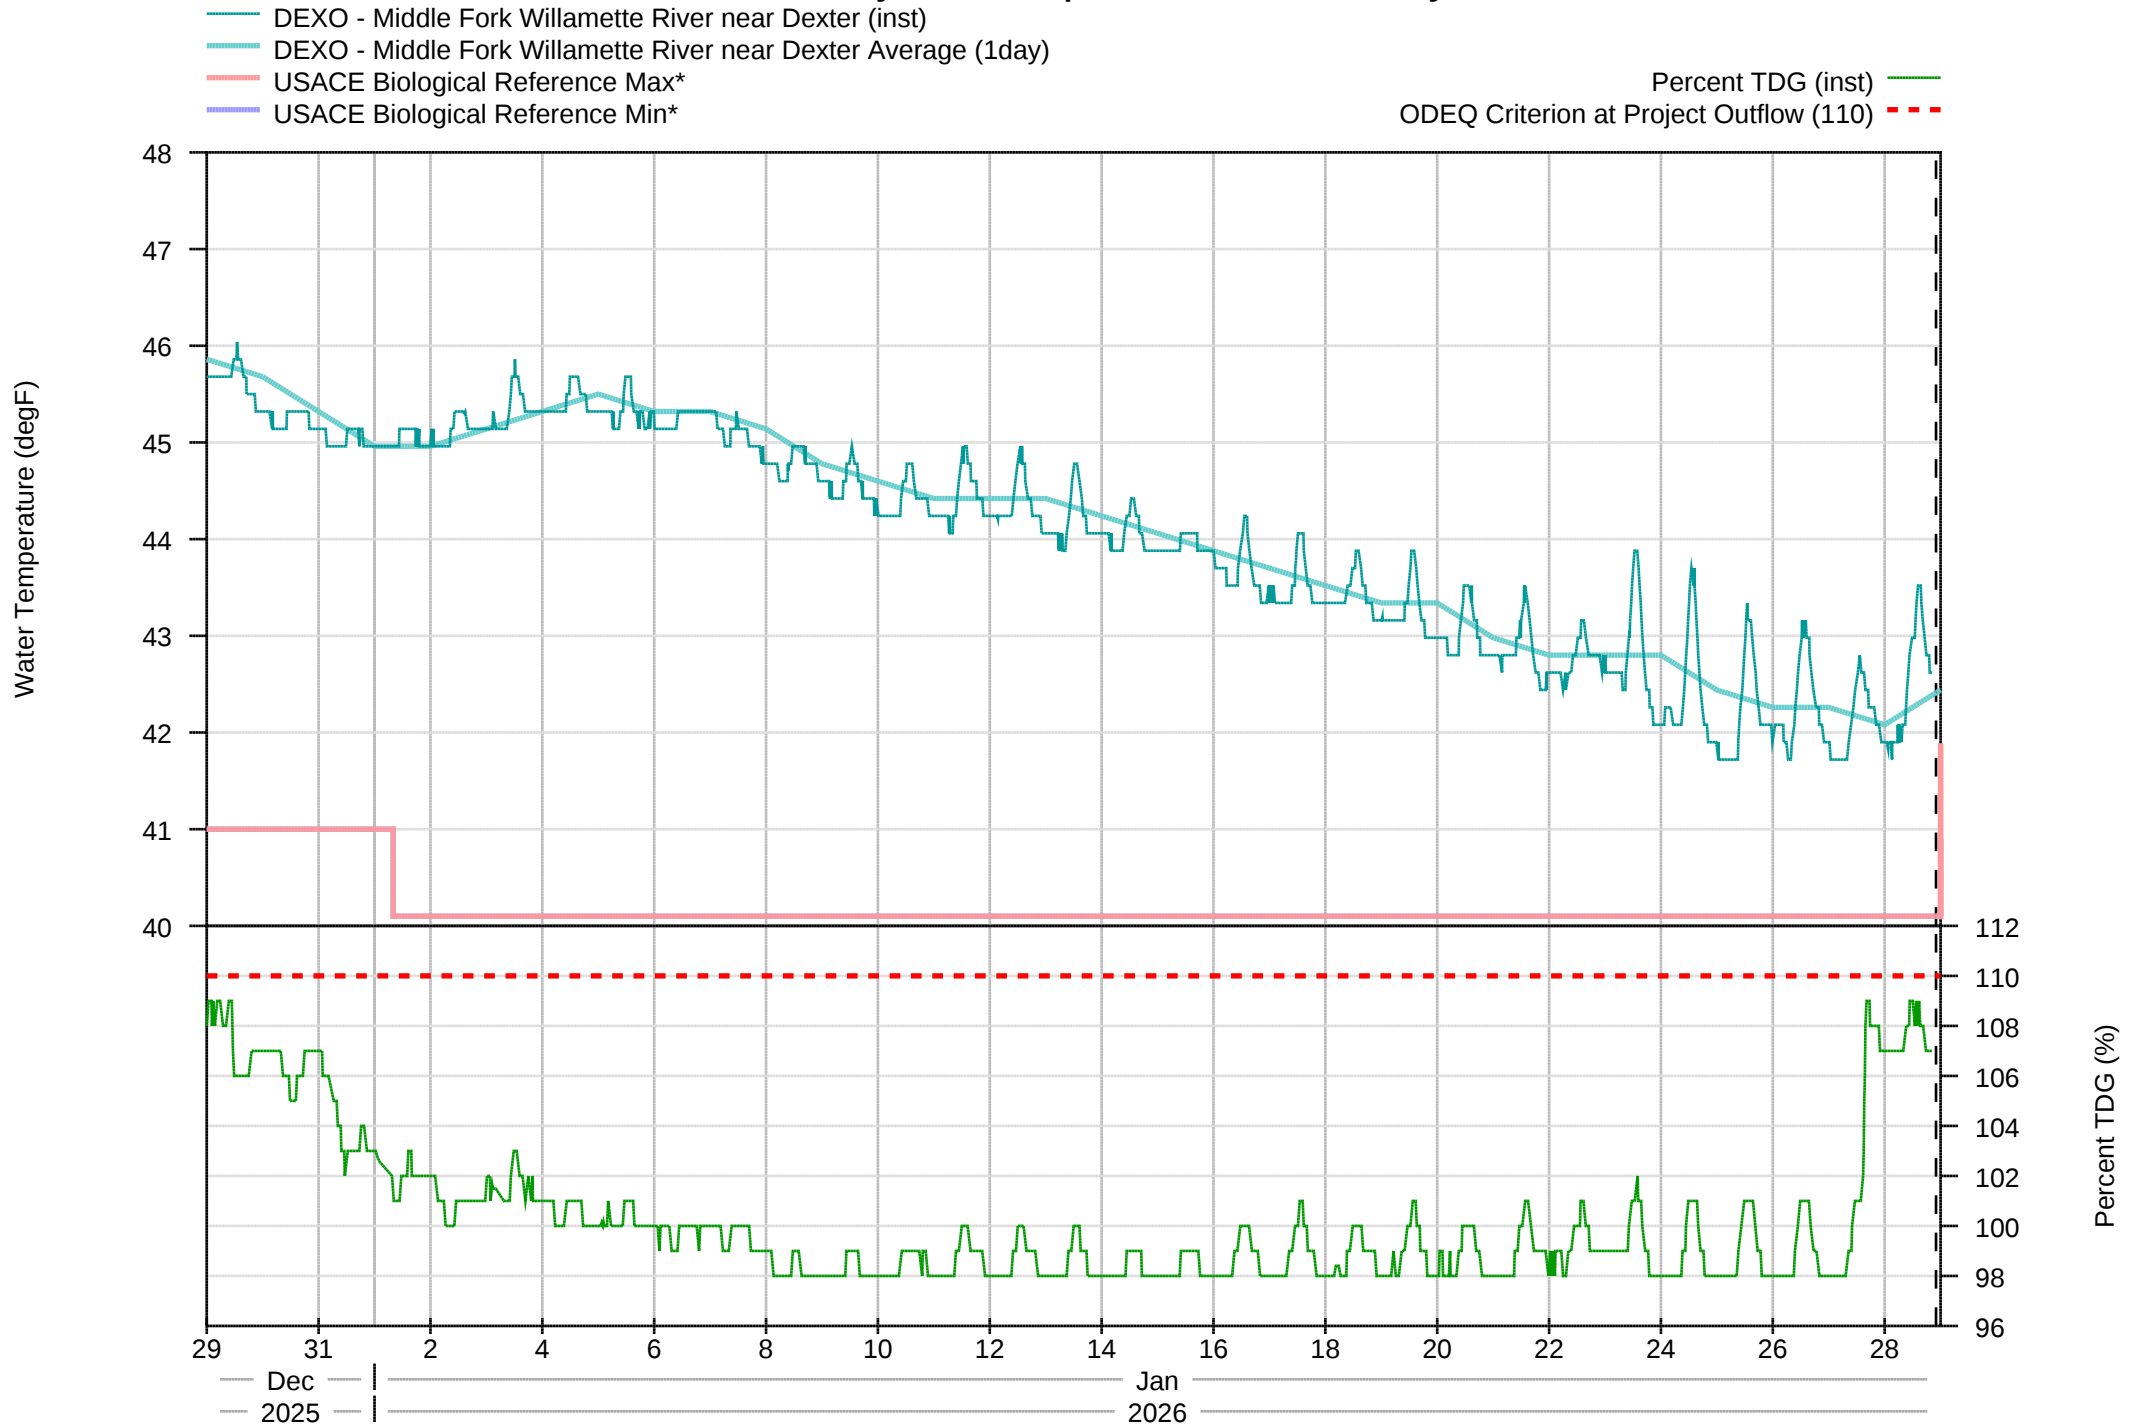


*The USACE Biological References for minimum and maximum temperatures are unofficial guidelines used by the USACE to compare with measured temperatures.

Dexter Project Temperatures - 365 days

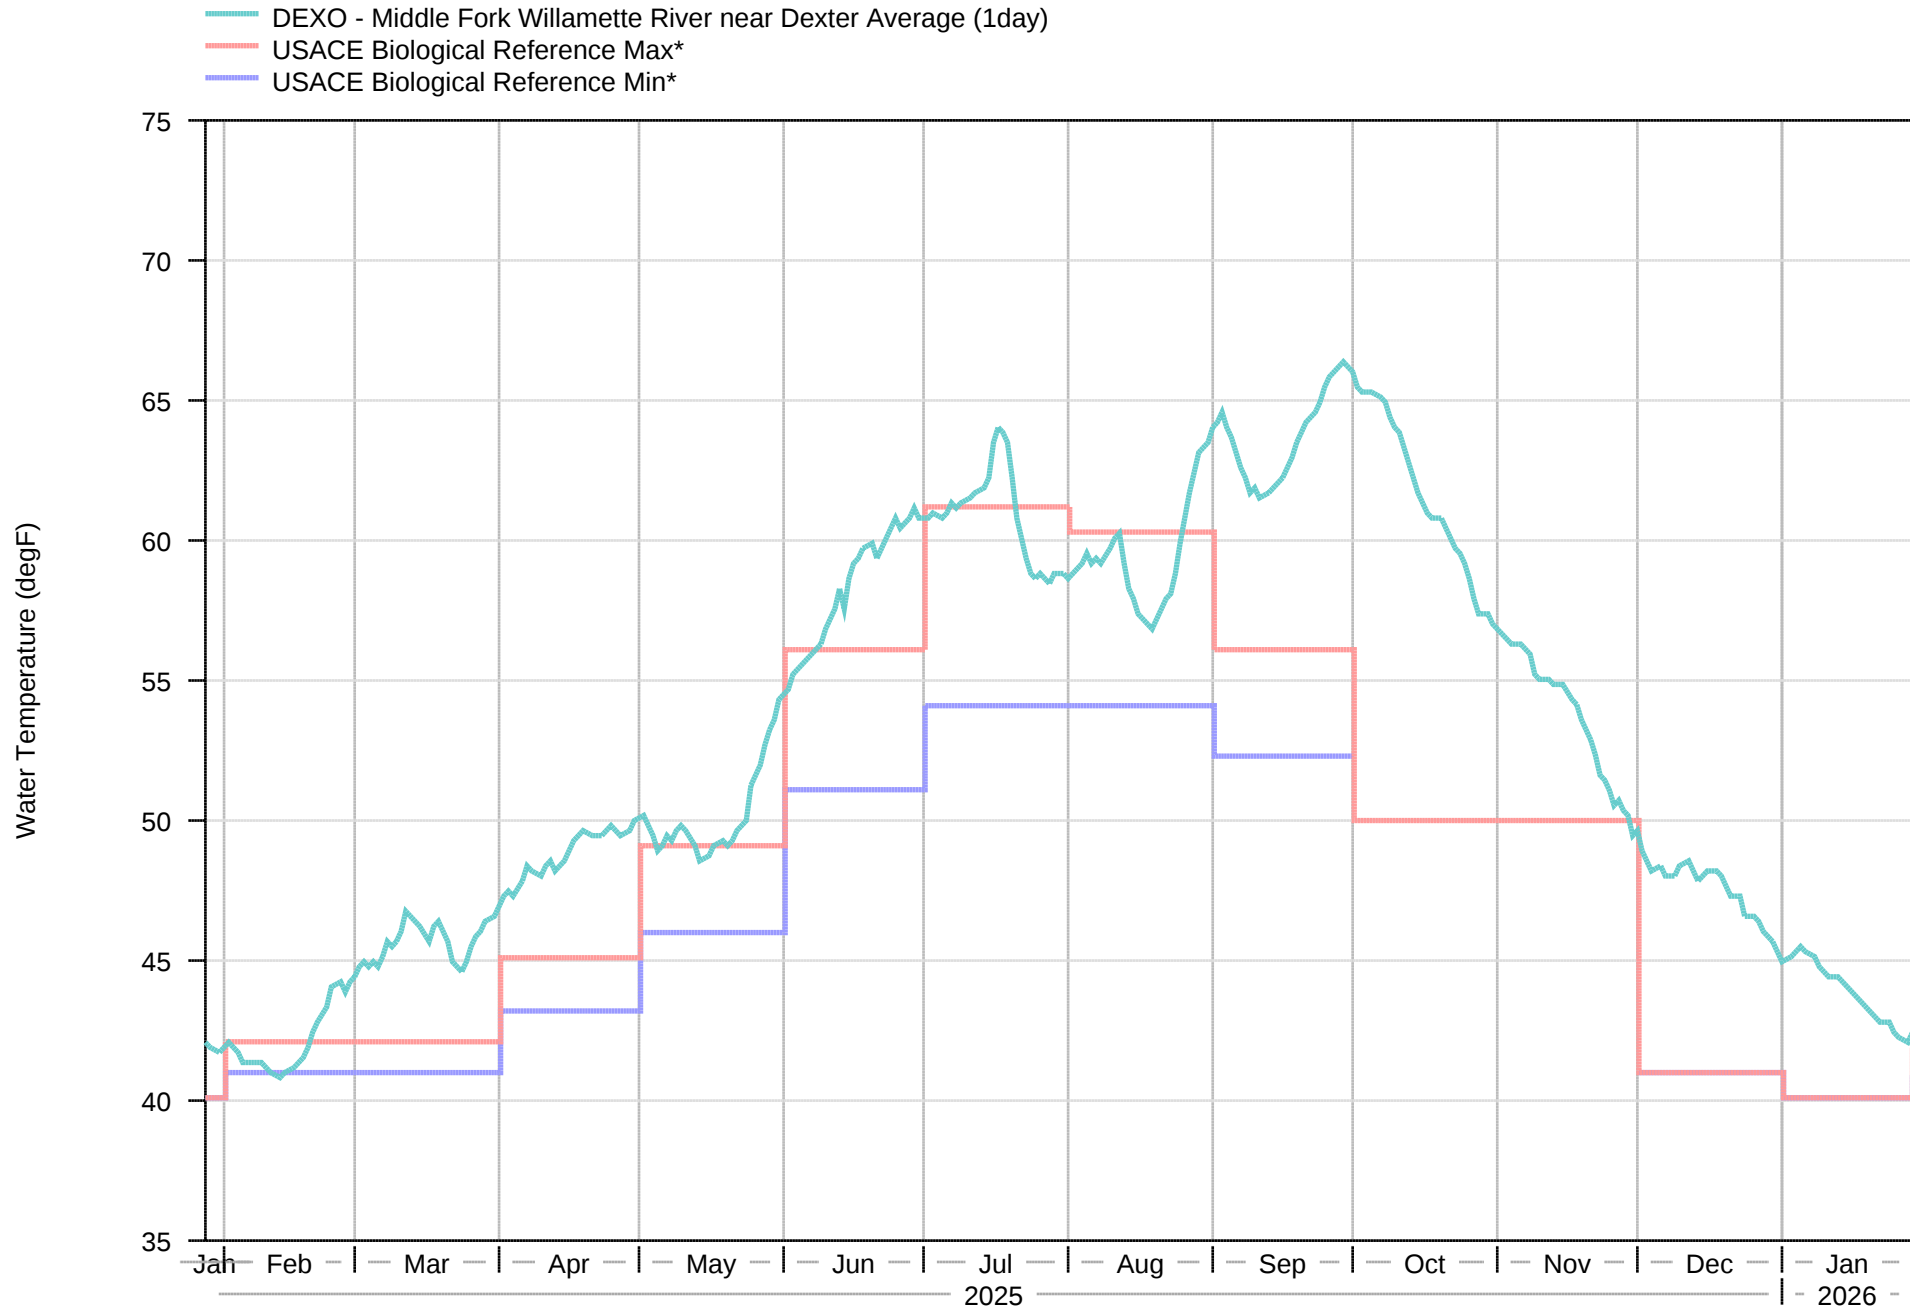

Dexter Project Turbidity - 30 days

DEXO Turbidity (inst)
JASO Turbidity (inst)

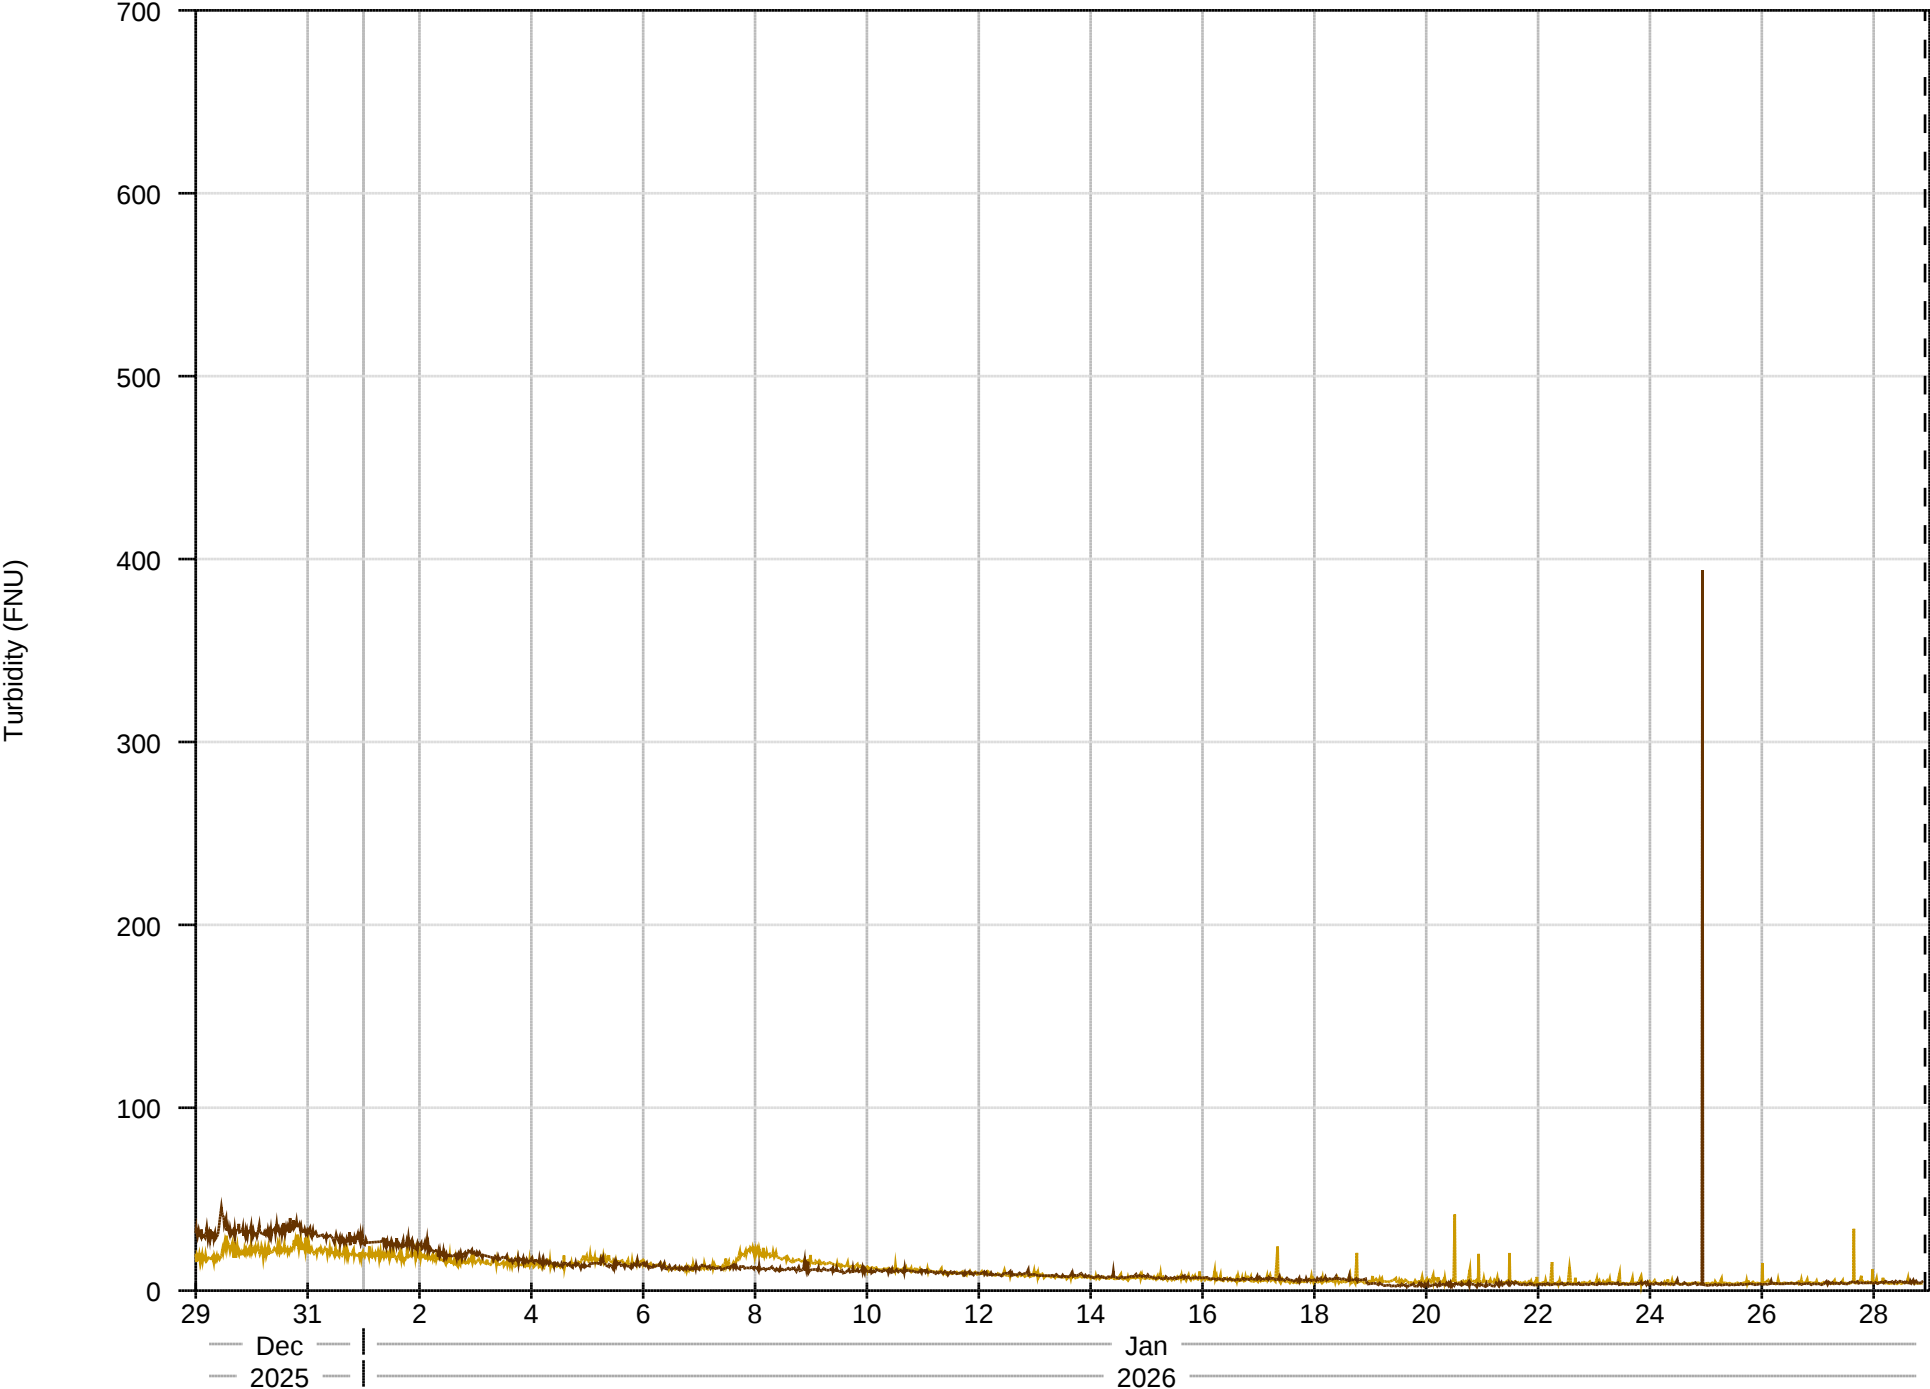

Dexter Project Turbidity - 365 days

DEXO Turbidity (inst)
JASO Turbidity (inst)

